

Auslegungstabelle *LegioClean® System DUO*

| Art.-Nr. | NL Zahl ¹ | Anschlussleistung (kW) | Spitzenvolumen 10 -> 45°C | | Dauerleistung dT = 35K | max.Druckverlust ² (mbar) | Wärmetauscher-Konfiguration ³ |
|----------|----------------------|---------------------------|------------------------------|-------|---------------------------|---|--|
| | | | (l/10min) | (l/h) | | | |

LegioClean® System *DUO 450-1*

| | | | | | | | |
|---------------|-----|----|-----|------|-----|------|---------|
| 33.280.049.06 | 3 | 10 | 234 | 438 | 245 | 0,54 | WTA 1-2 |
| | 3,4 | 20 | 248 | 656 | 490 | | |
| | 4,2 | 40 | 273 | 1090 | 980 | | |

LegioClean® System *DUO 450-2*

| | | | | | | | |
|---------------|-----|----|-----|------|------|------|---------|
| 33.280.049.07 | 4 | 12 | 267 | 471 | 245 | 0,90 | WTA 2-2 |
| | 5,5 | 20 | 311 | 719 | 490 | | |
| | 8 | 40 | 374 | 1190 | 980 | | |
| | 10 | 60 | 419 | 1644 | 1469 | | |

LegioClean® System *DUO 600-1*

| | | | | | | | |
|---------------|------|----|-----|------|------|------|---------|
| 33.280.069.07 | 7 | 20 | 350 | 758 | 490 | 0,97 | WTA 1-2 |
| | 9 | 40 | 397 | 1213 | 980 | | |
| | 11 | 60 | 440 | 1664 | 1469 | | |
| | 12,5 | 80 | 471 | 2101 | 1959 | | |

LegioClean® System *DUO 750-1*

| | | | | | | | |
|---------------|------|-----|-----|------|------|------|---------|
| 33.280.079.17 | 9 | 20 | 397 | 805 | 490 | 0,81 | WTA 1-2 |
| | 11 | 40 | 440 | 1256 | 980 | | |
| | 12,5 | 60 | 471 | 1695 | 1469 | | |
| | 14,5 | 80 | 510 | 2143 | 1959 | | |
| | 16 | 100 | 538 | 2579 | 2449 | | |


LegioClean® System *DUO 750-2*

| | | | | | | | |
|---------------|----|-----|-----|------|------|------|---------|
| 33.280.079.18 | 11 | 20 | 440 | 848 | 490 | 0,81 | WTA 2-4 |
| | 19 | 40 | 592 | 1408 | 980 | | |
| | 25 | 60 | 691 | 1916 | 1469 | | |
| | 29 | 80 | 753 | 2386 | 1959 | | |
| | 34 | 100 | 828 | 2869 | 2449 | | |
| | 37 | 120 | 871 | 3320 | 2939 | | |

¹ Leistungskennzahl NL nach DIN 4708 bei Puffertemperatur von 70°C

² max. Druckverlust dP in Wärmetauschern

³ Wärmetauscher-Konfigurationen

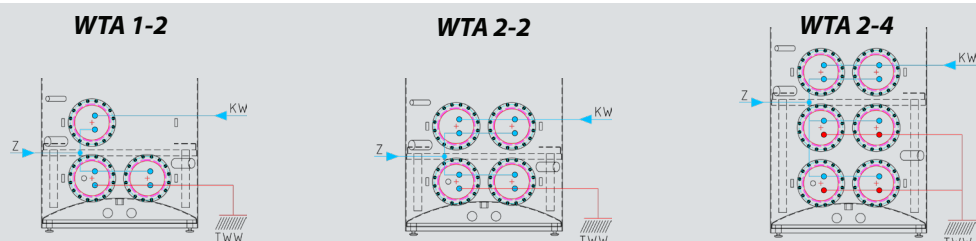

Auslegungstabelle *LegioClean® System DUO*

| Art.-Nr. | NL Zahl ¹ | Anschluss- leistung (kW) | Spitzenvolumen 10 -> 45°C | | Dauer- leistung dT = 35K | max.Druck- verlust ² (mbar) | Wärme- tauscher- Konfiguration ³ |
|----------|-------------------------|------------------------------------|------------------------------|-------|------------------------------------|--|---|
| | | | (l/10min) | (l/h) | | | |

LegioClean® System *DUO 900*

| | | | | | | | |
|---------------|----|-----|-----|------|------|------|---------|
| 33.280.099.15 | 12 | 20 | 460 | 869 | 490 | 0,81 | WTA 2-4 |
| | 20 | 40 | 609 | 1425 | 980 | | |
| | 28 | 60 | 738 | 1963 | 1469 | | |
| | 33 | 80 | 813 | 2446 | 1959 | | |
| | 36 | 100 | 857 | 2897 | 2449 | | |
| | 39 | 120 | 899 | 3348 | 2939 | | |

LegioClean® System *DUO 1000*

| | | | | | | | |
|---------------|----|-----|-----|------|------|------|---------|
| 33.280.109.17 | 13 | 20 | 481 | 889 | 490 | 0,81 | WTA 2-4 |
| | 21 | 40 | 626 | 1442 | 980 | | |
| | 29 | 60 | 753 | 1978 | 1469 | | |
| | 34 | 80 | 828 | 2460 | 1959 | | |
| | 37 | 100 | 871 | 2912 | 2449 | | |
| | 40 | 120 | 913 | 3362 | 2939 | | |

LegioClean® System *DUO 1500*

| | | | | | | | |
|---------------|----|-----|-----|------|------|------|---------|
| 33.280.159.07 | 17 | 20 | 556 | 965 | 490 | 0,81 | WTA 2-4 |
| | 25 | 40 | 691 | 1508 | 980 | | |
| | 34 | 60 | 828 | 2052 | 1469 | | |
| | 40 | 80 | 913 | 2546 | 1959 | | |
| | 43 | 100 | 955 | 2996 | 2449 | | |
| | 45 | 120 | 982 | 3431 | 2939 | | |

¹ Leistungskennzahl NL nach DIN 4708 bei Puffertemperatur von 70°C

² max. Druckverlust dP in Wärmetauschern

³ Wärmetauscher-
Konfigurationen

